

ADDENDUM


REQUEST FOR QUALIFICATIONS
FOR
CONSTRUCTION MANAGER AT RISK FOR PHOENIXMART
INFRASTRUCTURE

Addendum Number: 1


Date Issued: January 21, 2014


Additional drawings:

Three drawings are added to the RFQ to provide clarification regarding the location of the potential construction.

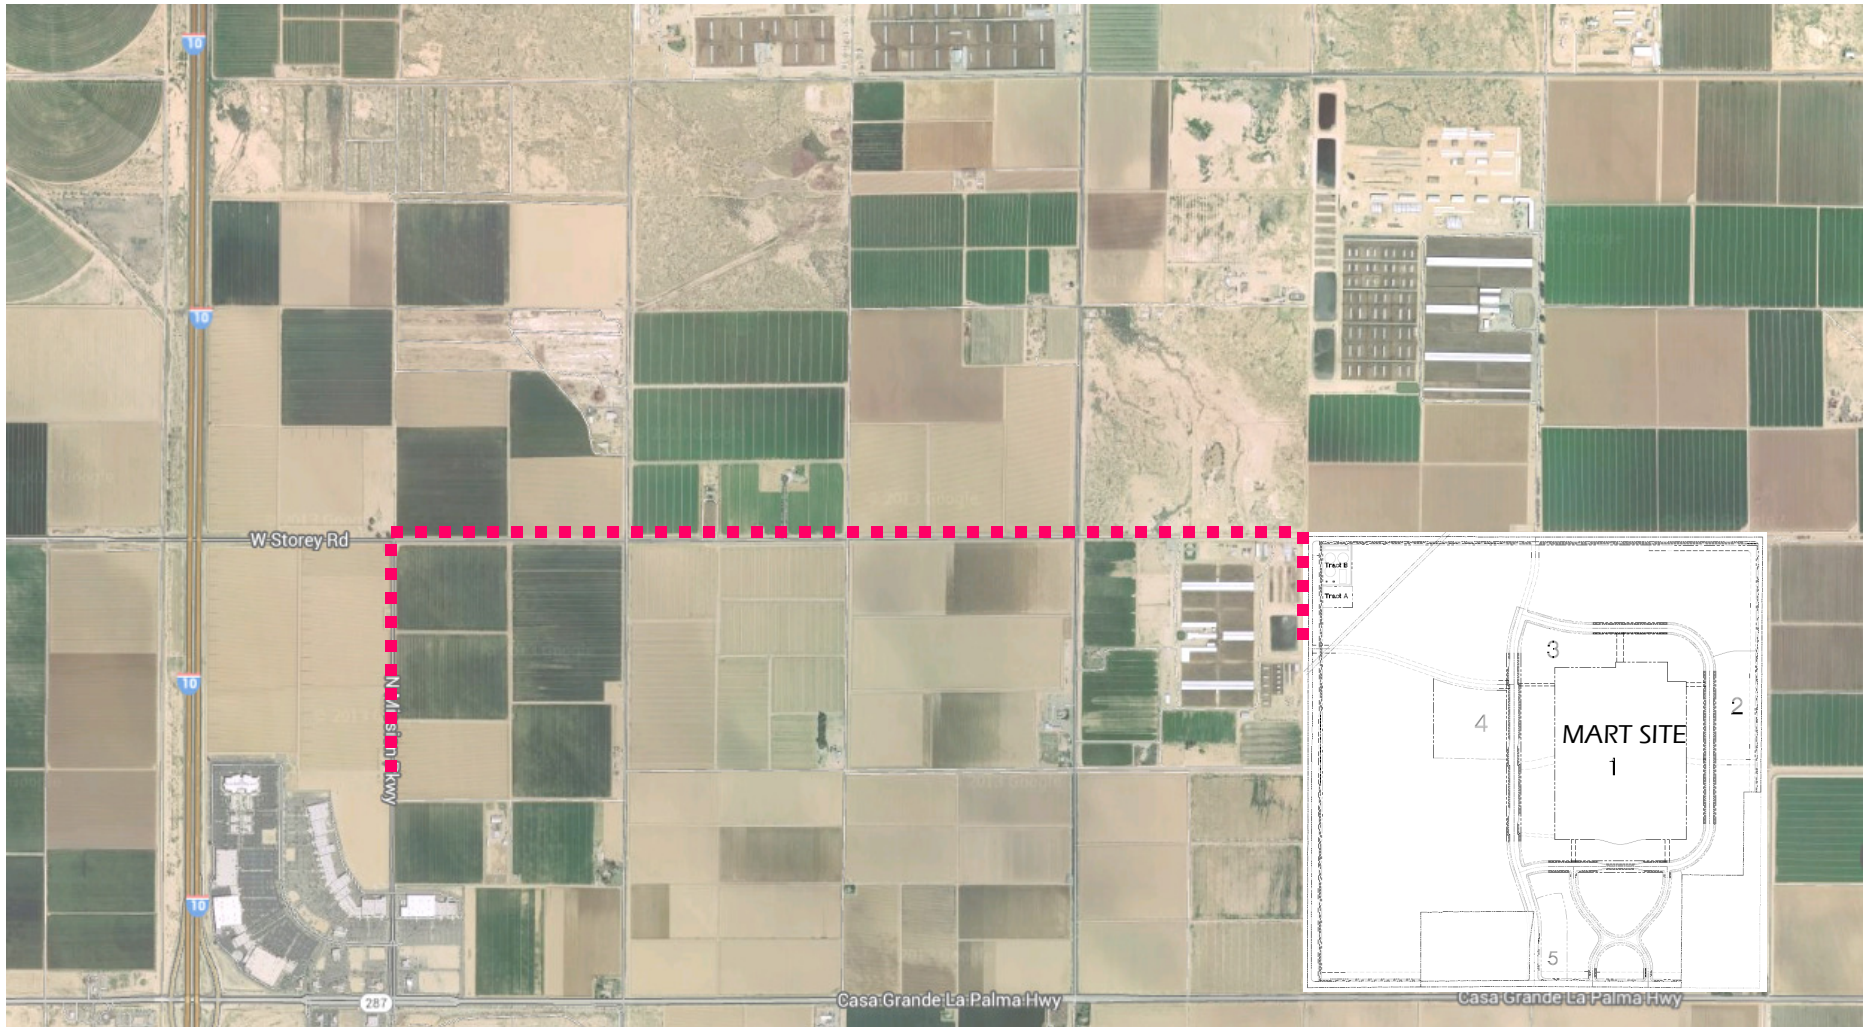

PROPOSED OFFSITE
WATER LINE

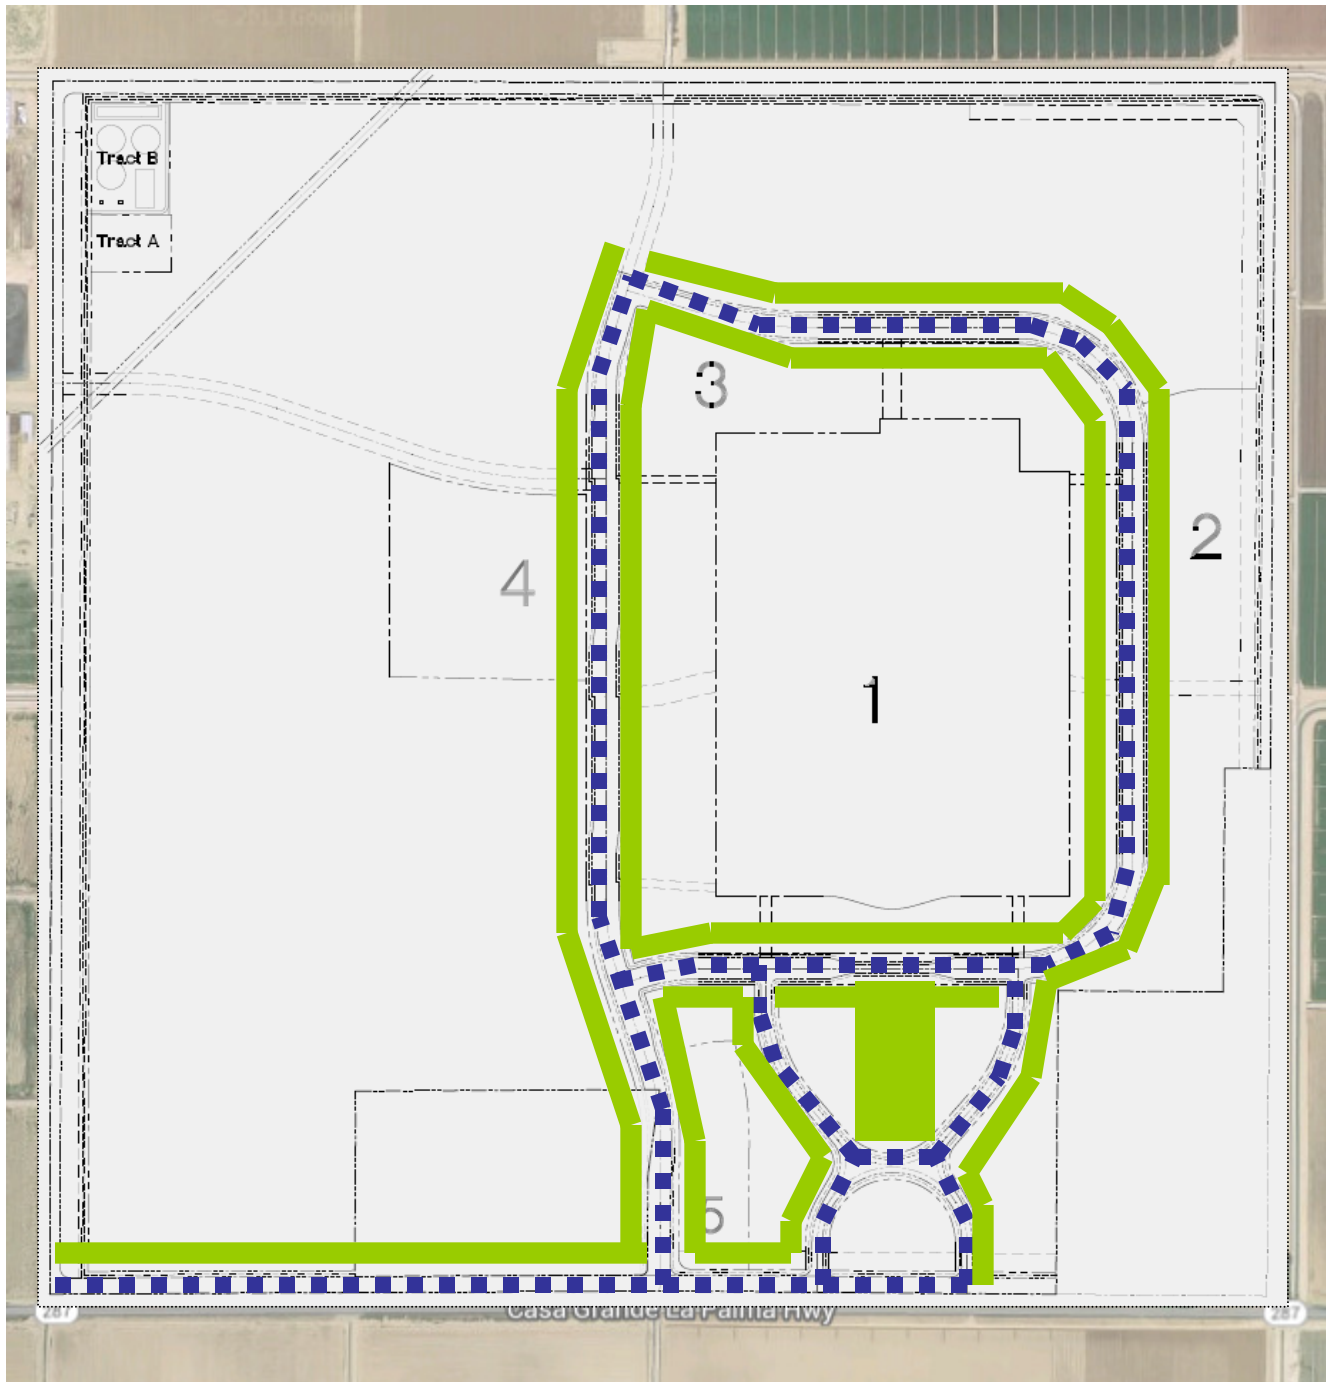

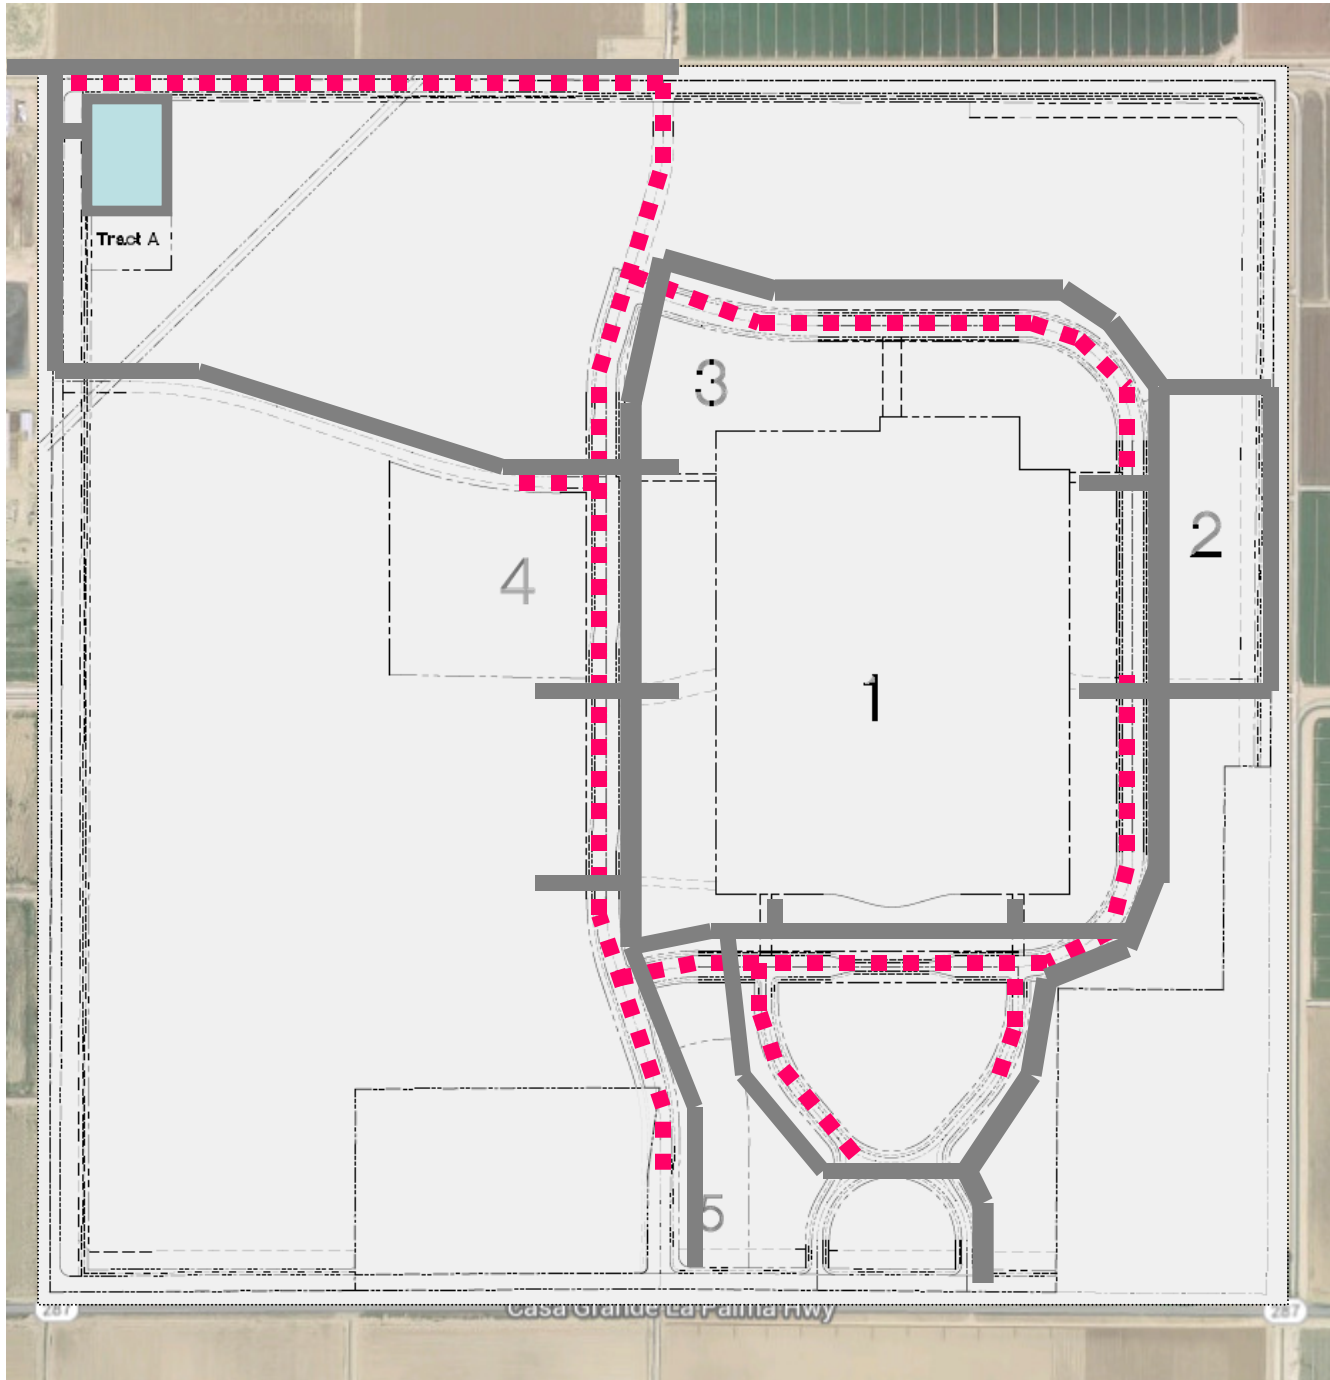

- WATER
- WATER CAMPUS
- - - SEWER